

# SS5K3

## ***Generator Automatic Voltage Regulator Operation Manual***



Self Excited Slip Ring Type Automatic Voltage Regulator  
with closed-loop feedback circuit  
Designed For Small Diesel and Gasoline Generators

# 1. SPECIFICATION

Sensing Input		Voltage Build-up
Voltage	16 ~ 25 VAC, 50/60 Hz	Residual voltage at AVR terminal > 2 VAC
Power Input		Thermal Drift
Voltage	60 ~ 100 VAC, 50/60 Hz	0.05% per °C change in AVR ambient
Output		Voltage Adjust Range
Voltage	Max. 100 VDC @ 85 VAC input	115 / 230 VAC ± 15%
Current	Continuous 3A	
	Intermittent 5A for 60 sec	Dimensions
Resistance	Min. 25 ohm	64.5mm L * 158.2mm W * 40mm H
Voltage Regulation		Weight
< ± 1% ( with 4% engine governing )		190 g ± 2%

# 2. SUMMARY

The EA5K3 Automatic voltage Regulator is a direct replacement for small brush type generators from 3 to 7.5KW. This AVR employs an enhanced closed-loop feedback circuit, which greatly improves voltage stability, also added is a new VOLT adjustment pot, not available in the original. This new AVR significantly improves generator performance.

# 3. WIRING & ADJUSTMENT

- 3.1 Figure 1, show the plug connections numbered 1, 2, 3 and 4.
- 3.2 Line 1 (white) and line 2 (green) are the sensing input lines, they are used to match the generator output voltage (115 / 230VAC) Some generators have an independent sensing connections, If this is your case, open wire 2 (green) and reconnect to its matching connector plug.
- 3.3 Line 3 (blue) and line 4 (Blue) are the AVR Power Input terminals
- 3.4 The independent red (+ Positive) and white wire ( - Negative) ending in spade terminals attach to the generators Slip Rings (F+ and F-)
- 3.5 Moving the voltage adjustment potentiometer (VOLT) located on the back and center of the AVR changes the output voltage ±15%; moving it clockwise increases voltage and moving it counter-clockwise decreases voltage.

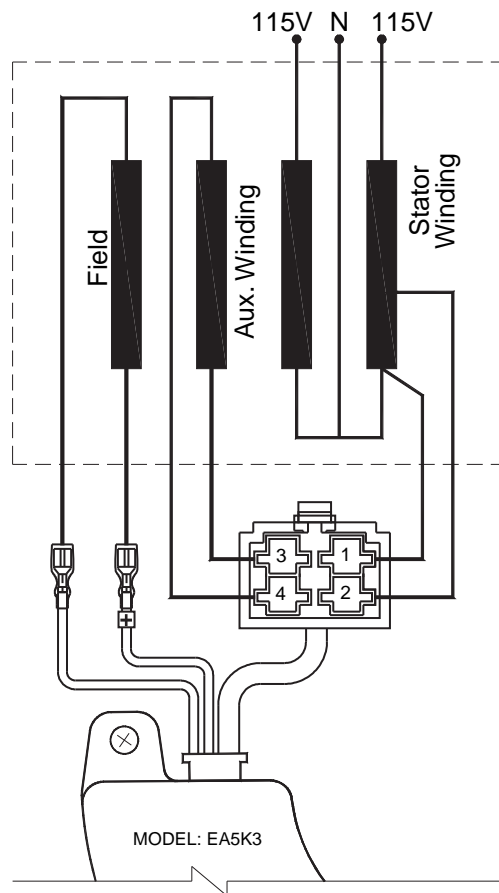


Figure 1 Connection

## 4. OUTLINE / DIMENSION

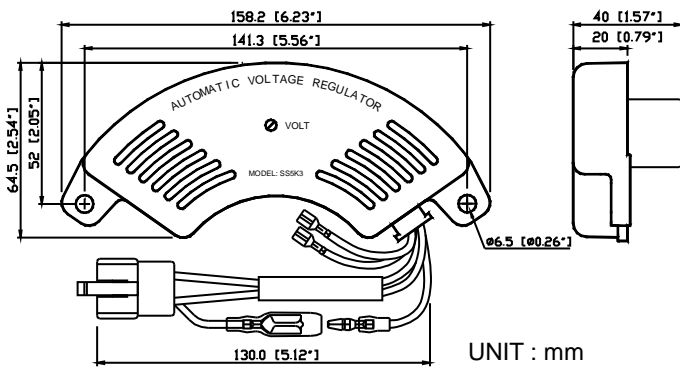


Figure 2 Outline Drawing

### ATTENTION

1. AVR can be mounted directly on the engine, genset, switchgear, control panel, or any position that will not affect operation. For dimension reference, please see Figure 2.
2. All voltage readings are to be taken with an average-reading voltmeter Meggers and high-potential test equipment must not be used. Use of such equipment could damage the AVR.
3. Secure all wiring connection. Do not install AVR at a place with high vibrations to prevent loose connections. For safety avoid contact with the AVR case while in operation.

## 5. COMPATIBLE REPLACEMENT

BRAND	PART NUMBER
ELEMAX	SH4000, SH5000, SH6000, SH7000
HONDA	EP3800, EP5000, EC6500
KAWASAKI	GE4300A, GE500AS, PP4000, PP6000
KUBOTA	GL6500S
SUZUKI	LTZ400
SAWAFUJI	SH4600EX, SH5300EX, SH6500EXS, SH7600EX
YAMAHA	EDL6500S

## 6. TROUBLE SHOOTING

SYMPTOM	CAUSE	CORRECTION
Voltage does not build up	F+, F- Loosen connection	Check F+, F- connection
	F+, F- Polarity reversed	F+, F- reverse connection
	Residual voltage less than 1.5V	Execute field excitation
	CN1 Connection incorrect	Reference from Figure 2 to correct connection
Out voltage high	Voltage over AC130 / 260V and can not be adjusted	Defective AVR. Please contact with service provider.